Cloud Energy

48(51.2)V LiFePO4 150Ah

Stackable Type

Please Read The Manual Carefully Before Using The Equipment.

www.cloudnewenergy.com info@cloudnewenergy.com

Cloudenergy 48V 150Ah Stackable LiFePO4 Deep Cycle Rechargeable Battery

PRODUCT OVERVIEW

BATTERY

Combination: 51.2V150Ah Dimension：L25.6*W16.53*H7.08inch

Metal Case Color: Orange+Black

TERMINAL & POST BOLTS

Terminal Size:
M8 (1.25mm Metric Thread)

Post Bolts:
M8 (1.25mm Metric Thread * 14mm Bolt Length)



(The bolts can be replaced with M8 bolts of other lengths based on actual needs.)

GENERAL INFORMATION

Operating Voltage:	51.2V
Charging Voltage:	58.4±0.75V
Max Continuous Load Power:	5120W
Max Continuous Charge/ Discharge Current:	100A

NOTICE BEFORE USING

Step 1

CONTACT US at info@cloudnewenergy.com to activate the FIVE-YEAR WARRANTY

Step 2

PULL OUT Packaging box.

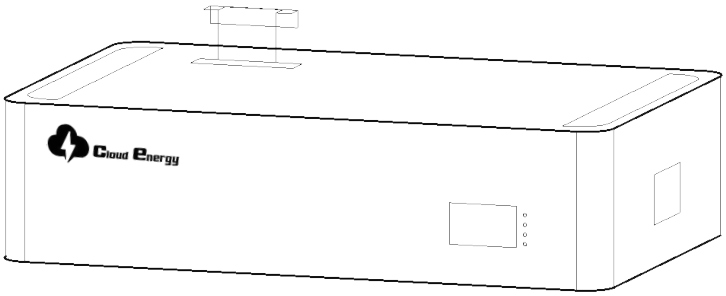

Step 3

TEST The Battery Voltage with Multimeter

>48v To step 4
<48V Contact us at info@cloudnewenergy.com to help solve the problem

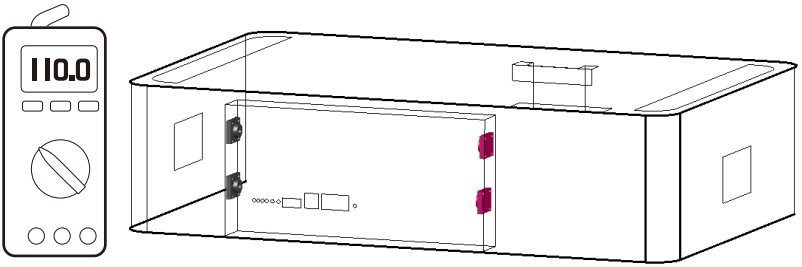

Step
4

FULLY CHARGE The Battery Separately

(Refer to Page 04 for battery charging methods)

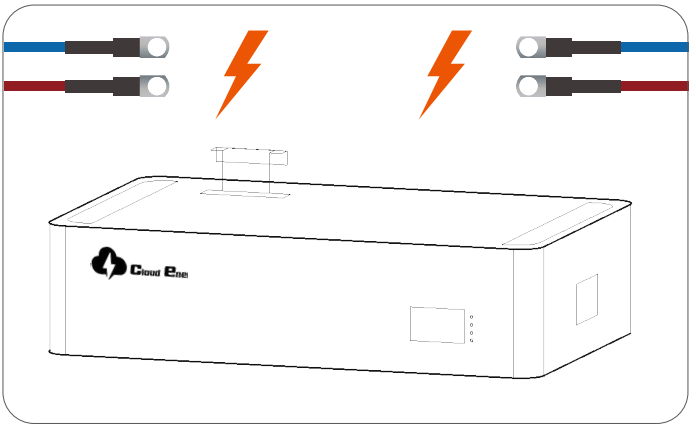

Step
5

CONNECT To Use

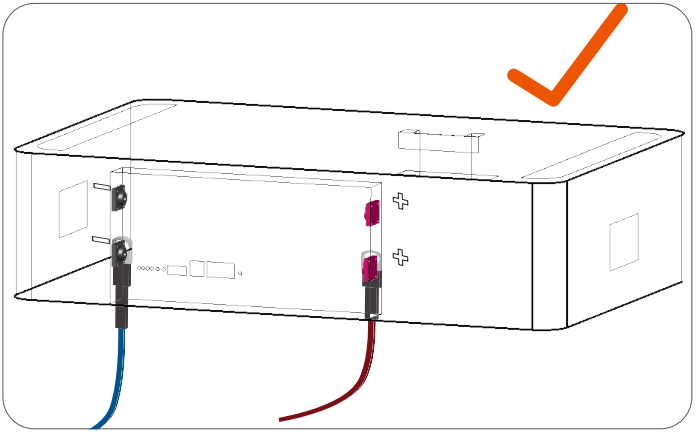

CONTENTS

BATTERY PARAMETERS page 01

THINGS TO KNOW BEFORE USING page 03

Long Term Storage 03

CHARGING METHODS page 04

Background Information
- The Voltage When Charging & Discharging 04
- Battery Charging Logic 05
  - LiFePO4 Battery Charging Mode
  - Lead Acid Battery Charging Mode

Method Ⅰ
- Solar Panel(s) & Controller 07
  - Solar Panel
  - Controller
  - Controller Settings

Method Ⅱ
- Battery Charger 08

Method Ⅲ
- Alternator / Generator 08

HOW TO ESTIMATE THE BATTERY CAPACITY page 09

State of Charge (SOC) 09

PARALLEL CONNECTION page 10

The Premise of Connection 10

Limitation for Series/Parallel Connection 10

How to Connect Batteries 11

- Accessory Recommendation
- Step 1 Wear Insulating Gloves
- Step 2 Voltage Balancing Before Connection
- Step 3 Total Input & Output Connection
- Step 4 Rebalancing Every Six Months

INVERTER SETTINGS page 16

WHAT TO DO WHEN THE BATTERY STOPS WORKING? page 17

BATTERY-PACK MAIN PARAMETERS

Cell	Prismatic LiFePO4 Battery
Nominal Capacity	150Ah
Usable Capacity	150Ah
Nominal Voltage	51.2V
Energy	7680Wh
Charge Method	CC / CV
Charge Voltage	58V±0.75V
Recommend Charge Current	45A (0.3C)

Battery Management System (BMS) Board	100A
Max. Continuous Charge / Discharge Current ①	110A
Max. Discharge Current 5 Seconds	120A
Max. Continuous Load Power ②	5120W

① The maximum continuous current that the battery can withstand.
② The maximum continuous output power that the battery can support.

Internal Impedance	⩽40mΩ
Battery Pack Case	Steel Plate Cold Common (SPCC)
Dimension	L18.9*W17.64*H6.3 inch
	L480*W450*H160 mm
Temperature Range	Charge: 0°C to 50°C / 32°F to 122°F
	Discharge: -20°C to 60°C / -4°F to 140°F
	Storage: -10°C to 50°C / 14°F to 122°F

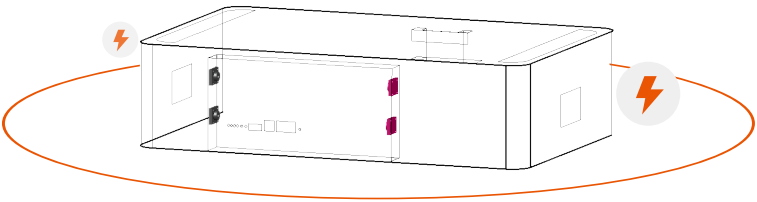

THINGS TO KNOW
BEFORE USING

Please take care to avoid metal or conductive objects touching the positive and negative terminals of the battery at the same time during your operation, otherwise it is likely to cause a short circuit.

DO NOT install the battery with the top or the post bolt facing down. If ou are not sure about the installation direction, please contact to confirm the direction.

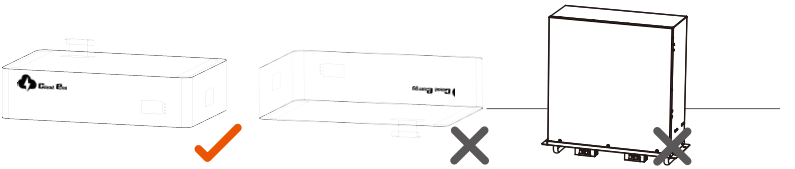

Tightly screw in the post bolts. Having loose battery terminals will cause the terminals to build up heat resulting in damage to the battery.

This battery is not intended to be used to start any devices, please **DO NOT use it as a starting battery.**

Suggestions for **Long-term Storage:**

- Temperature

  The battery can be operated at a temperature of -20°C to 60°C / -4°F to 140°F, and a temperature between 10°C to 35°C / 50°F to 95°F is ideal for long-term storage. Store in a fireproof container and away from children.

- Capacity

  For a longer-lasting product, it is best to store your battery at a 50% charge level and recharge every three months if it is not going to be used for a long time.

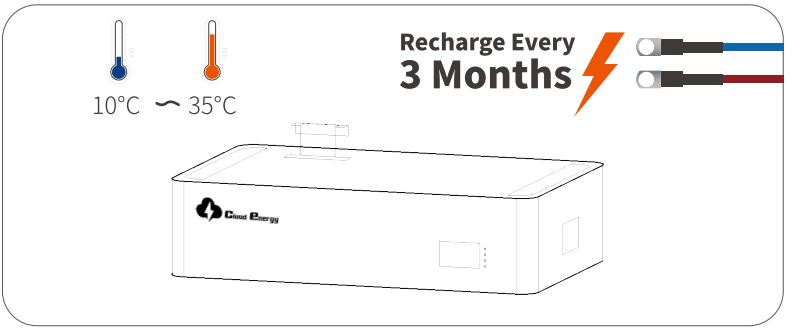

CHARGING METHODS

THE VOLTAGE WHEN CHARGING & DISCHARGING

Based on the characteristics of Lithium Iron Phosphate (LiFePO4) batteries, the voltage measured by all LiFePO4 batteries during charging/discharging is not the real voltage of the battery. Therefore, after charging/discharging and disconnecting the battery from the power source, the voltage of the battery will gradually drop/increase to its real voltage.

If you need to test the real voltage of the battery, please disconnect all the connections to the battery and test its voltage after putting it aside for over 30 mins.

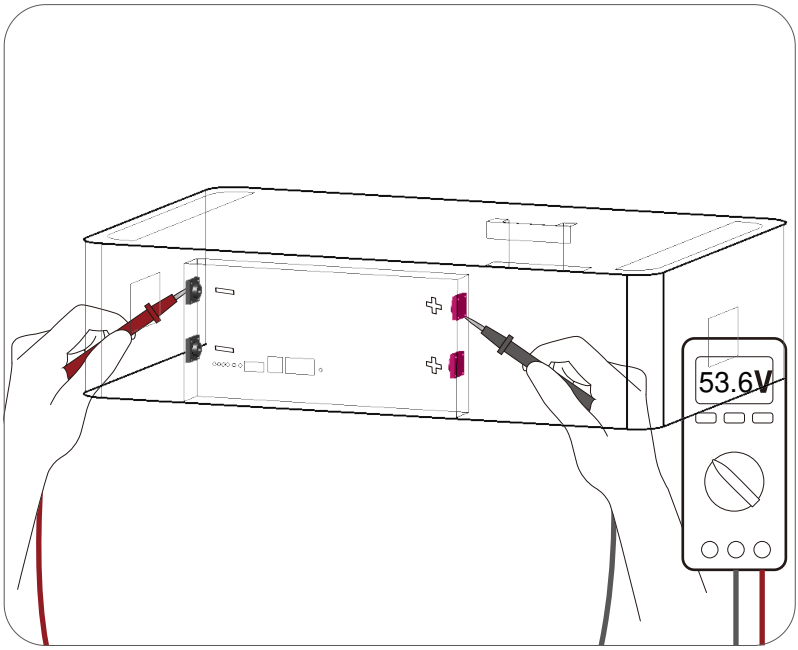

Tips When Testing The Battery Voltage by A Multimeter

①Put the red probe (+) tightly on the tightly screwed positive post bolt, and the black probe (-) on the tightly screwed negative post bolt.

②Do not touch the metal part of the probes with your hands during use.

BATTERY CHARGING LOGIC

The material characteristics of the LiFePO4 battery determine that its charging curve is obviously different from that of a lead-acid battery. Compared with a lead-acid battery, the LiFePO4 battery has a simpler charging process and mode. Therefore, it is recommended to select LiFePO4 for your charging mode.

If LiFePO4 mode is not available, please refer to the recommended parameters on Page 07~08 for setting.

LiFePO4 Battery Charging Mode

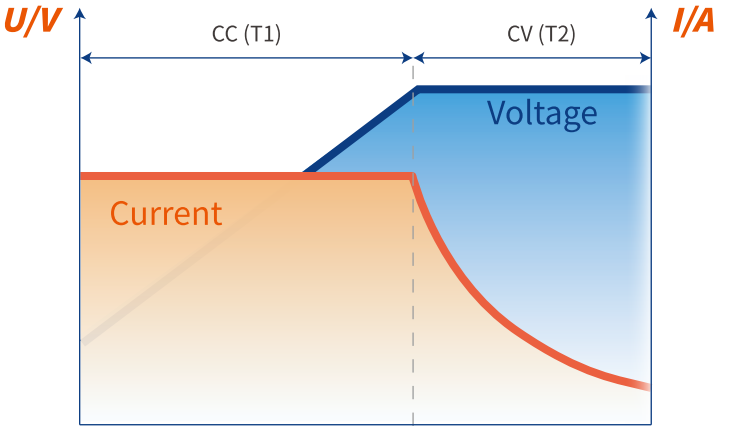

LiFePO4 Battery Charging Curve

○ CC (Constant Current) Phase (T1)

In the beginning, a discharged battery will be charged with a constant current and voltage will be climbing steadily until reaching the constant voltage setpoint which varies for different charging methods.

○ CV (Constant Voltage) Phase (T2)

The battery maintains a constant voltage during this phase while the current gradually decreases to 2A (0.02C) which is also known as tail current①. At this point, the charging is cut off and the battery is fully charged.

① Tail Current (A) = Battery Capacity * 0.02C. E.g., 100Ah*0.02C= 2A tail current.

Lead Acid Battery Charging Mode

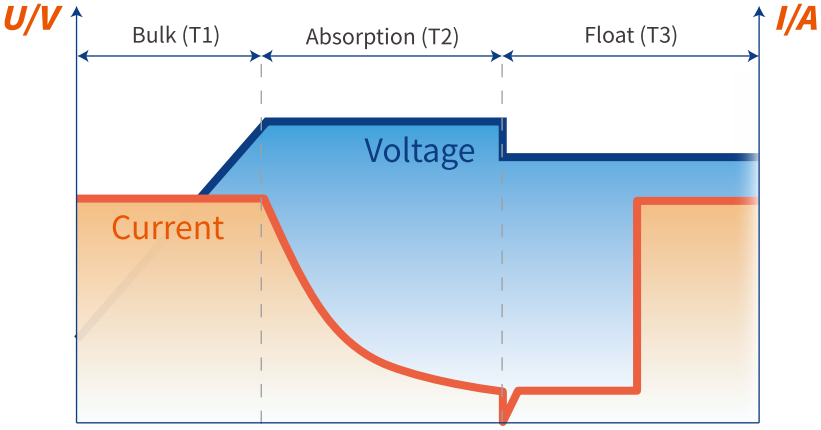

Lead Acid Battery Charging Curve

○ Bulk / Boost Phase (T1)

In the beginning, a discharged battery will be charged with maximum current and voltage will be climbing steadily until reaching the absorption voltage setpoint.

(This phase is basically equivalent to the CC phase of LiFePO4 battery charging.)

○ Absorption Phase (T2)

The battery reaches the absorption voltage setpoint and holds the voltage constant while the current gradually decreases until the battery is becoming full (within 10-20%). Generally, absorption will not exceed 3 hours to prevent overcharging.

(This phase is basically equivalent to the CV phase of LiFePO4 battery charging.)

○ Float Phase (T3)

After the absorption stage, the voltage of the battery will reduce to the float voltage setpoint and the current will also reduce to a low maintenance mode to prevent the battery from discharging and offsetting any self-discharge. Heavier battery discharge may set the controller back to Bulk/Boost or Absorption to replenish energy lost while energy is available.

(LiFePO4 battery does not have this charging phase.)

SOLAR PANEL(S) & CONTROLLER

Solar Panel

☆ Recommend Power: ⩾1500W

- The battery can be fully charged in one day (with effective sunshine 4.5hrs/day) by 1500W solar panels.
- It may take more than one day to fully charge the battery by 1500W solar panels since the duration and intensity of light would be a great factor for their charging efficiency.

Controller

☆ Recommend Charging Current:

30A (0.2C)	The battery will be fully charged in around 5hrs to 100% capacity.
75A (0.5C)	The battery will be fully charged in around 2hrs to around 97% capacity.

☆ Recommend Charging Mode: 51.2(58.4V) **LI (LiFePO4)**

Controller Settings

Refer to the below parameters if you need to manually set up your controller. As different types of batteries have different charging modes (refer to Page 05-06), it is recommended to set only the following parameters for LiFePO4 batteries. The settings for other types of batteries do not apply to LiFePO4 batteries except for the following settings

CHARGING	Charge /Bulk /Boost Voltage	58.2V/ 58.4V
	Absorption Voltage	58.2V/ 58.4V
	Over Voltage Disconnect	59.2V
	Over Voltage Reconnect	54.4V
	Tail Current	2A (0.02C)
DIS-CHARGING	Under Voltage Warning	43.5V
	Under Voltage Recover	45V
	Low Voltage Disconnect	40.5V
	Low Voltage Reconnect	46.5V

BATTERY CHARGER

Use 54.75V lithium iron phosphate (LiFePO4) battery charger to maximize the capacity.

☆ Recommend Charging Voltage: Between 58.2V to 58.4V

☆ Recommend Charging Current:

30A (0.2C)	The battery will be fully charged in around 5hrs to 100% capacity.
75A (0.5C)	The battery will be fully charged in around 2hrs to around 97% capacity.

Tips

① Connect the charger to the battery before connecting it to the grid power in case of sparks.

② It' s recommended to disconnect the charger from the battery after fully charging.



ALTERNATOR / GENERATOR

LiTime battery can be charged by an alternator or generator.

If the alternator/generator supports DC output, a DC-to-DC charger needs to be added between the battery and the generator; if the alternator/generator supports AC output, please refer to the recommendations in "Battery Charger" above to add a suitable battery charger between the battery and the generator.

☆ Recommend Charging Voltage: Between 53.25V to 54.75V

☆ Recommend Charging Current:

30A (0.2C)	The battery will be fully charged in around 5hrs to 100% capacity.
75A (0.5C)	The battery will be fully charged in around 2hrs to around 97% capacity.



HOW TO ESTIMATE THE BATTERY CAPACITY

STATE OF CHARGE (SOC)

The battery capacity could be roughly estimated by its rest voltage (not charging/discharging voltage). As there are subtle differences in the voltage of each battery, the below parameters are for reference only.

Rest Voltage:The voltage needs to be tested at rest (with zero current) after 30 mins of disconnecting from the charger & loads.

CAPACITY	CHARGE VOLTAGE
100%	53.8V
99%	53V
90%	52.5V
70%	52V
40%	51V
30%	50V
20%	49V
10%	45V
1%	☆ 43V (recommend low voltage disconnect voltage)
0%	42V

PARALLEL CONNECTION

THE PREMISE OF CONNECTION

To connect in parallel, batteries should meet the below conditions:

a. identical batteries with the same battery capacity (Ah) and BMS (A);

b. from the same brand (as lithium battery from different brands has their special BMS);

c. purchased in near time (within one month).

LIMITATION FOR SERIES/PARALLEL CONNECTION

Support connecting up to 16 identical batteries in parallel for up to:
48V 2400Ah battery system.

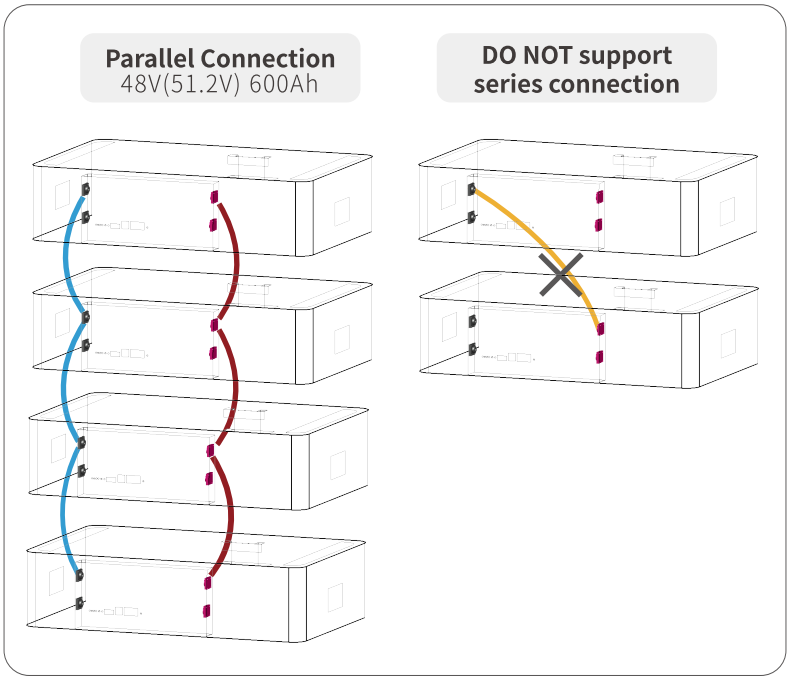

HOW TO CONNECT BATTERIES

Step1 Wear Insulating Gloves

Wear Insulating Gloves for protection before connecting. Please pay attention to operation safety in the process of connection.

Step2 Voltage Balancing Before Connection

Below two steps are necessary to reduce the voltage difference between batteries and let the battery system perform the best of it in parallel.

Step **1**

Fully charge the batteries separately.
(voltage at rest: ⩾53.8V)

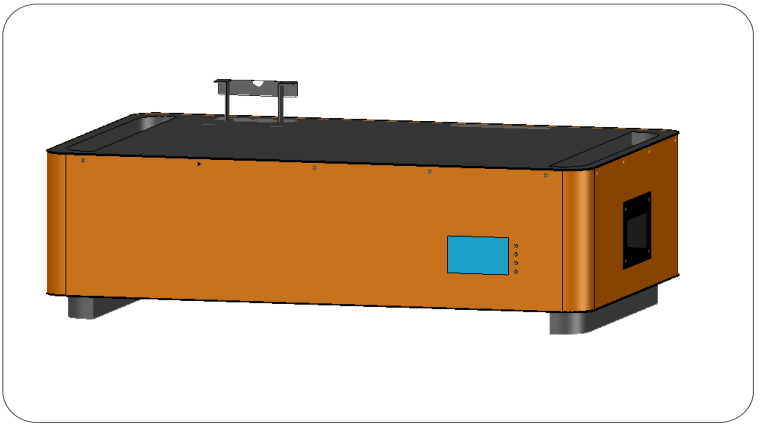

Step **2**

Connect the batteries one by one in parallel, and leave them together for 12~24hrs. After the battery voltages have been balanced, the paralleled battery system can be connected to the load referring to Step 3 on Page 13.

Connect Batteries in Parallel ⊕ to ⊕ ⊖ to ⊖

Parallel Connection
48V(51.2V) 600Ah

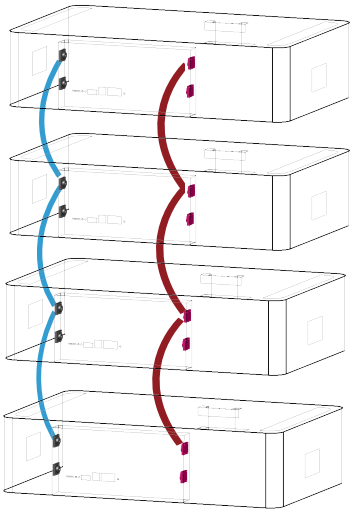

Recommend Battery-to-Battery Connection Cable: 6AWG Copper Cable.

After parallel connection, the capacity of the battery system will be doubled according to the number of batteries you connect.

E.g. If two 48V 100Ah batteries are connected in parallel, the battery system will be 48V 200Ah.

Step3 Total input & Output Connection without cables.

Step 1 Pull up the handle.

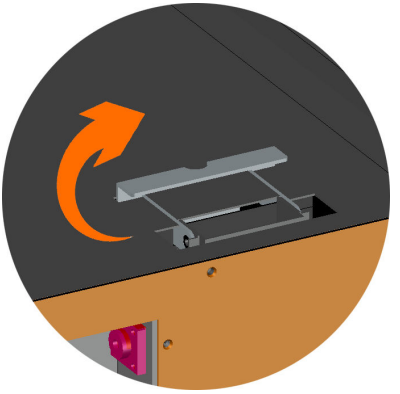

Step 2 Press the handle down.

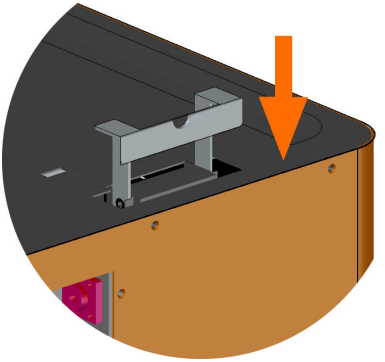

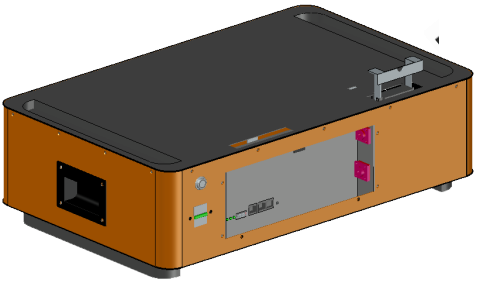

Step 3

Complete the operation before parallel connection.

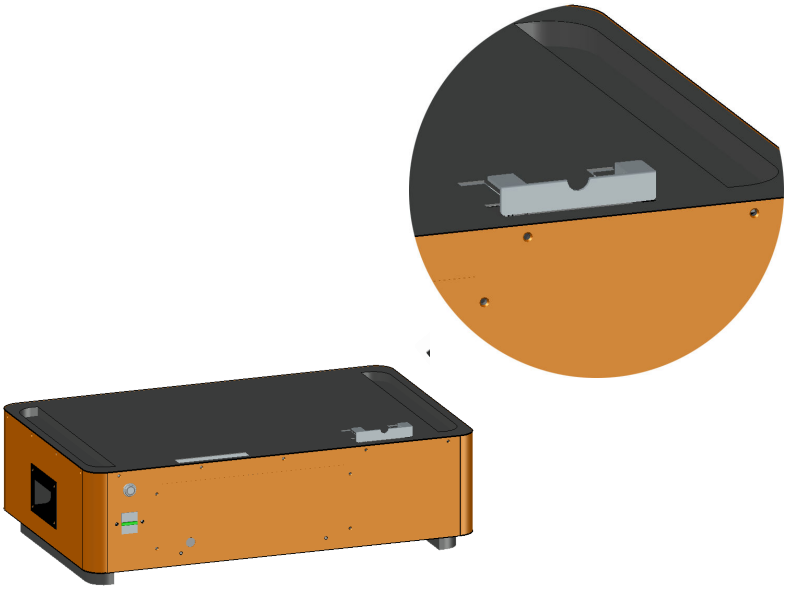

Step 4

Each battery can be successfully paralleled by stacking.

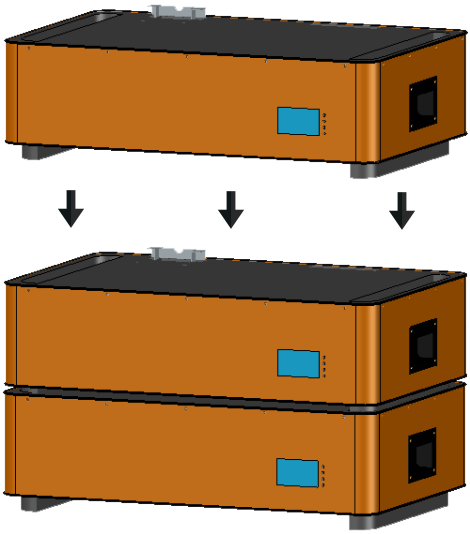

51.2V 600Ah **Battery System:**

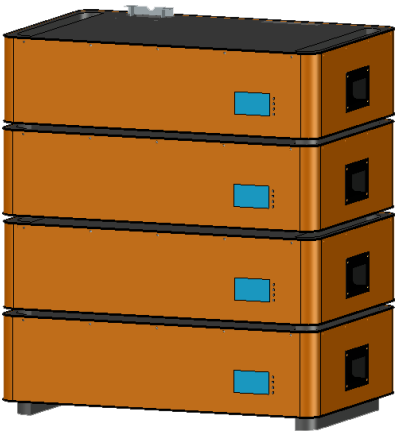

51.2V 600Ah Battery System



Solar Panels



Solar Inverter

YARD LIGHT
(50W)

TV
(100W)

MICROWAVE OWEN
(800W)

COFFEE MACHINE
(1000W)

FRIDGE
(1200W)

WATER HEATER
(2000W)

↑ Various Loads
Supporting Max. 30,720 Load Power

INVERTER SETTINGS

METHOD ONE (RECOMMEND)

Select“51.2(58.4 V) LI (LiFePO4) Mode”

METHOD TWO

If method one is not available, select “User Mode” to enter values according to below parameters.

CHARGING	Charge Voltage	58.4 V
	Over Voltage Disconnect	59.2 V
	Over Voltage Reconnect	54.4 V

DIS-CHARGING	Under Voltage Warning	43.5V
	Under Voltage Recover	45V
	Low Voltage Disconnect	40.5V
	Low Voltage Reconnect	46.5V

The above setting parameters **apply to common inverters on the market** (such as Victron, Renogy, Growatt, Xantrex, Go Power, Lux Power, etc.). Different brands have slightly different descriptions or naming methods for each parameter. **Please directly set the parameters with the same meaning.**

If the inverter parameters to be set are special or cannot correspond to one of the above items, please contact info@cloudnewenergy.com for confirmation.



WHAT TO DO WHEN THE
BATTERY STOPS WORKING?

When the battery

Can’ t work or Can’ t be charged or Voltage < 40 v

It has 85% chances that BMS has shut it off for protection, and you could try one of below ways to activate the battery.

GENERAL STEPS

If the BMS has cut off the battery for protection, follow the below steps to activate it.

Step 1

Cut off all the connections from the battery

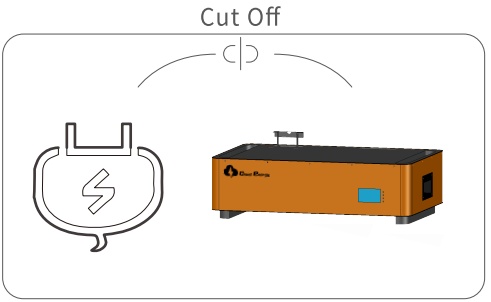

Step 2

Leave the battery aside for 30mins

Then the battery will automatically recover itself to normal voltage (> 40 V) and can be used after fully charged.

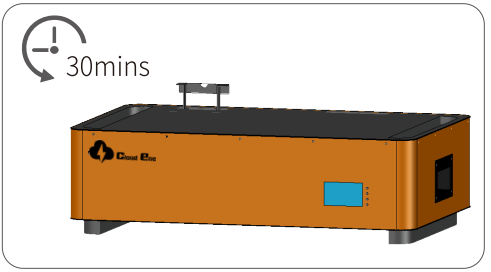

If the battery is unable to recover itself after the above steps, please try activating by **USING A CHARGER WITH A 0V CHARGING FUNCTION TO FULLY CHARGE THE BATTERY.** ①

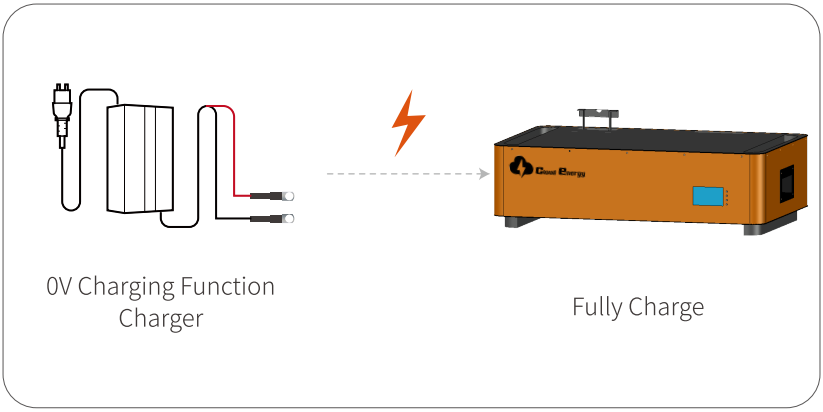

① The charger can charge the battery starting from 0V.

After activated (voltage > 37.5V) and fully charged by the normal charging method, it can be used normally.

ATTENTION

Caution: Risk of Fire, Explosion or Burns
DO NOT Short circuit
DO NOT Reverse connections from the charger to the battery
DO NOT Disassemble
DO NOT Throw into fire or incinerate
DO NOT Heat above 70°C / 158°F

WARNING

BATTERY DISPOSAL

The electrodes of the waste battery should be wrapped with insulating paper to prevent fire and explosion.

PROHIBITION OF DISASSEMBLY

Never disassemble the cells.
The disassembling may generate an internal short circuit in the cell, which may cause gassing, firing, explosion, or other problems.

The electrolyte is harmful.
Li-Fe battery should not have liquid from electrolyte flowing, but in case the electrolyte comes into contact with the skin, or eyes, physicians shall slush the electrolyte immediately with fresh water and medical advice is to be sought.

PROHIBITION OF DUMPING OF CELLS INTO WATER

Do not soak the battery in which the liquid, like water, seawater and non-alcoholic drinks, fruit juice, coffee or other drinks.

PROHIBITION OF DISASSEMBLY

If any abnormal features of the cells are found such as damages in a plastic envelope of the cell, deformation of the cell package, smelling of an electrolyte, an electrolyte leakage and others, the cells shall never be used anymore.
The cells with a smell of the electrolyte or a leakage shall be placed away from the fire to avoid firing or explosion.

PROHIBITION OF USING IN BELOW PLACES

Do not use the battery in a place with strong static electricity and a strong magnetic field, otherwise, it is easy to damage the battery safety protection device and bring hidden danger.

www.cloudnewenergy.com
info@cloudnewenergy.com